



Province of British Columbia

Water Sustainability Act

CONDITIONAL WATER LICENCE


The holder of a Certificate of Public Convenience and Necessity issued under the *Utilities Commission Act* and the *Water Utility Act* is hereby authorized to divert and use water as follows:

- a) The aquifer on which the rights are granted is Lower Nicola Unconsolidated.
- b) The point of well diversion is located as shown on the attached plan.
- c) The date from which this licence shall have precedence is March 29, 1996.
- d) The purpose for which this licence is issued is waterworks.
- e) The maximum quantity of water which may be diverted is 36505.183 cubic metres per year provided the maximum daily diversion does not exceed 100.0142 cubic metres.
- f) The period of the year during which the water may be used is the whole year.
- g) The land upon which the water is to be used and to which this licence is appurtenant is the undertaking of the licensee.
- h) The authorized works are a well, distribution system, hydrants, pipe, reservoir, meters, pump, pump house, and pressure reducing valve stations which shall be located approximately as shown on the attached plan.
- i) The construction of the said works has been completed and the water is being beneficially used. The licensee shall continue to make regular beneficial use of the water in a manner authorized herein.
- j) This licence is issued under the *Water Sustainability Act* (the Act). The exercise of rights under the licence is subject to the Act and its regulations, the terms and conditions of the licence, orders under the Act and the rights of licensees whose rights have precedence on the stream or on an aquifer. The licensee must comply with all such requirements, as well as the provisions of all other applicable enactments. In exercising rights under the licence, the licensee must exercise reasonable care to avoid damaging land, works, trees or other property, and must make full compensation to the owners for damage or loss resulting from construction, maintenance, use, operation or failure of the works.

- k) The licensee shall install a flow measuring device to the satisfaction of an Engineer under the *Water Sustainability Act*.
- l) The licensee shall retain flow meter records for inspection upon request by an Engineer under the *Water Sustainability Act*.
- m) The works authorized under clause (h) hereof shall be maintained to the satisfaction of an Engineer under the *Water Sustainability Act*.
- n) The Holder of this licence must affix well ID plate(s) to the well(s) as shown on the attached plan.



Patrick Farmer
Assistant Water Manager

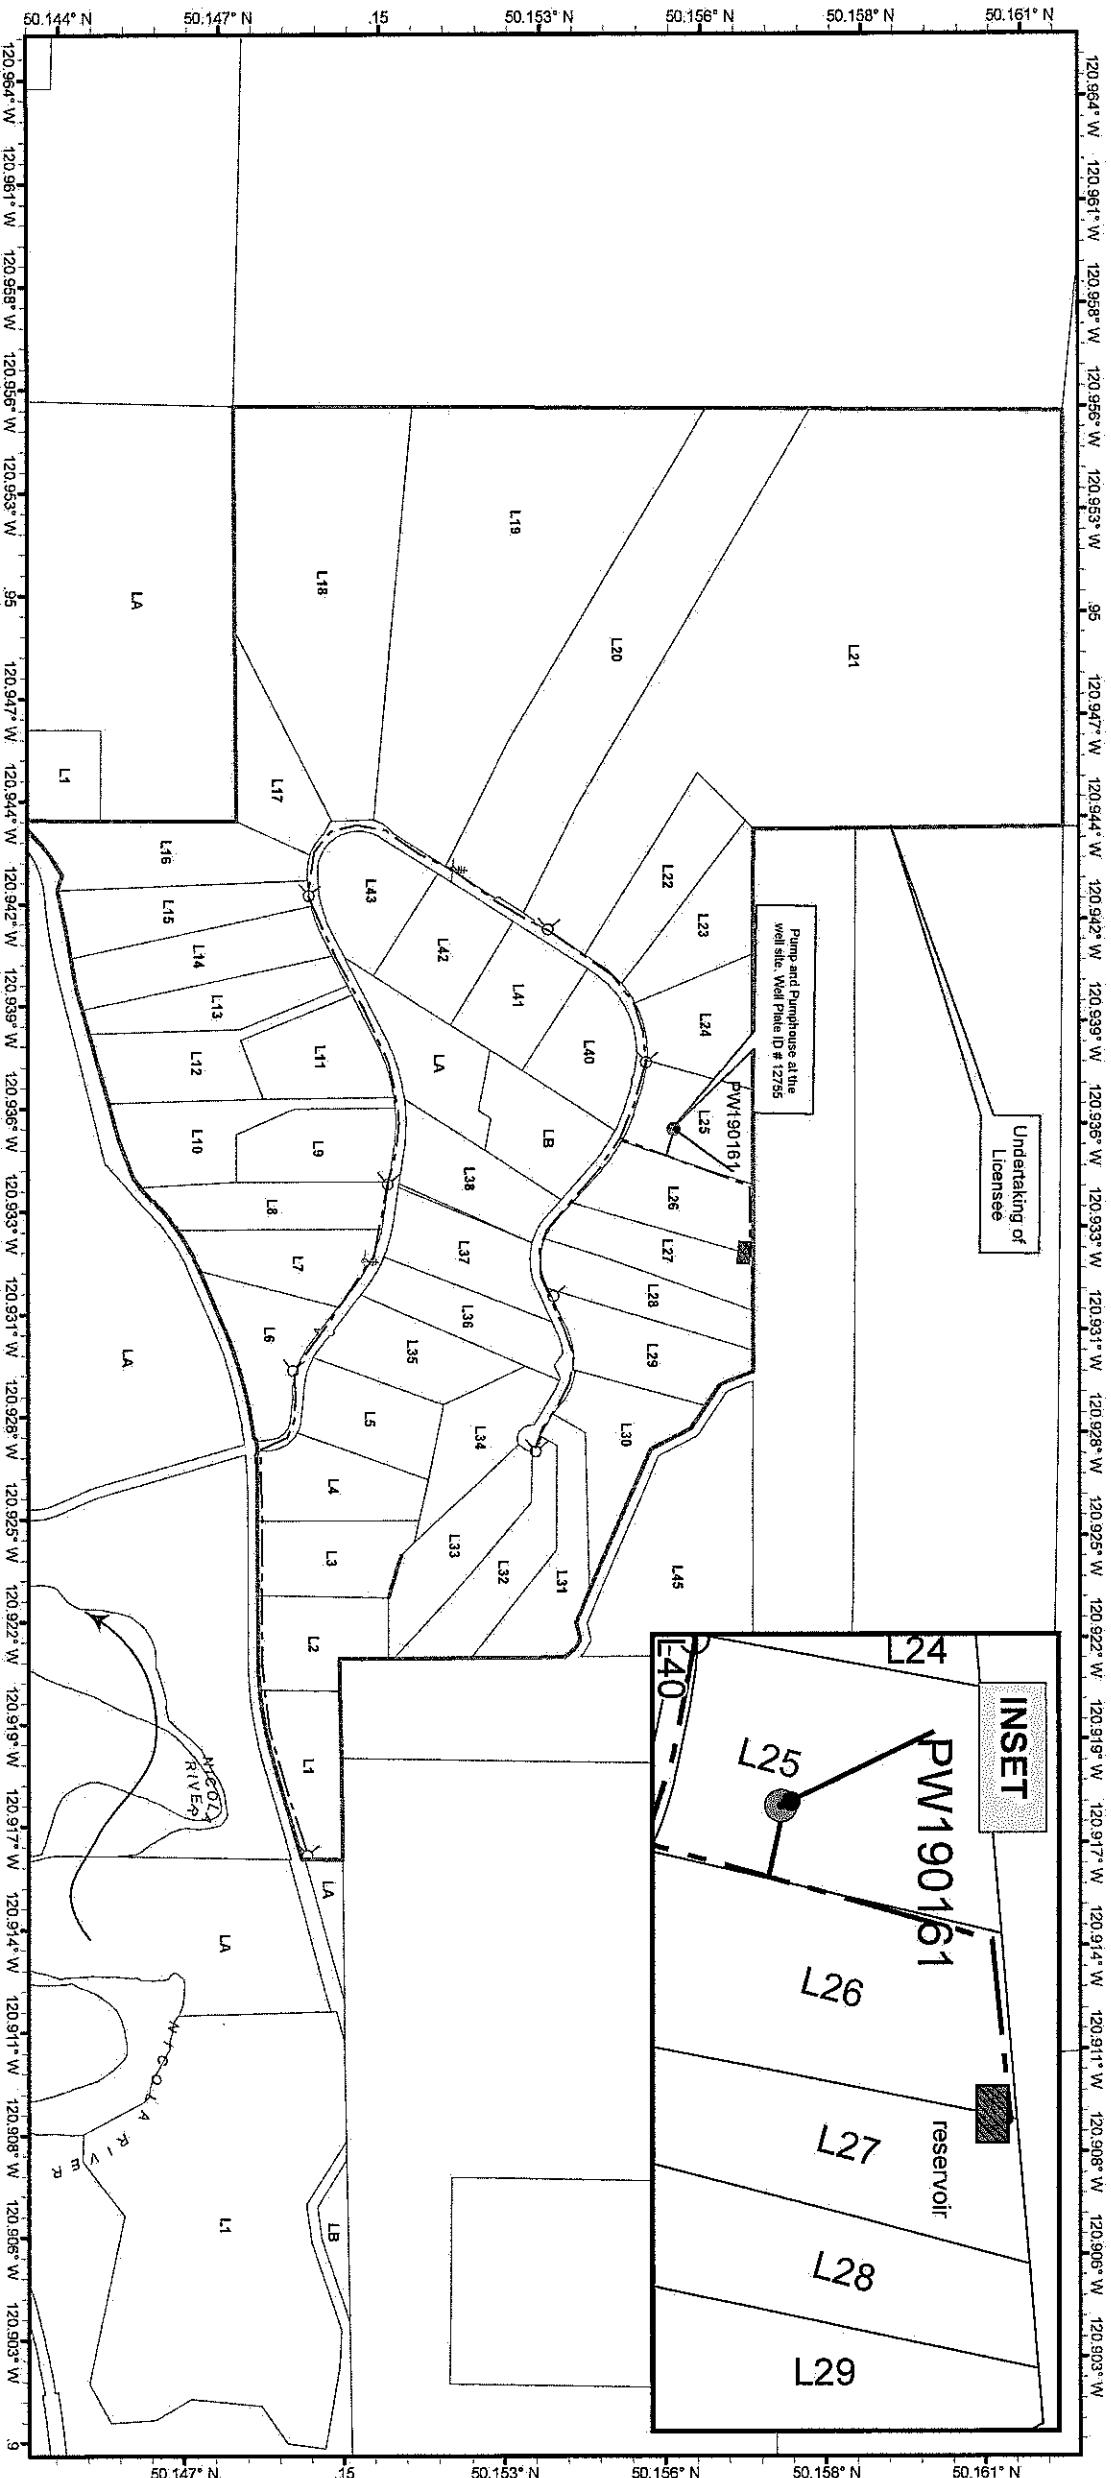

Point of Well Diversion: ●

Works points:

- Reservoir
- Fire hydrant
- Pressure Reducing valve

Pipeline:

- Pump
- Pump House

Direction of Flow: →


The boundaries of the land to which this licence is appurtenant are shown thus: ————

Lower Nicola Unconsolidated Aquifer under Sunshine Valley Estates

Scale: 1:14,000



Licence: C500007
 File: 20001565

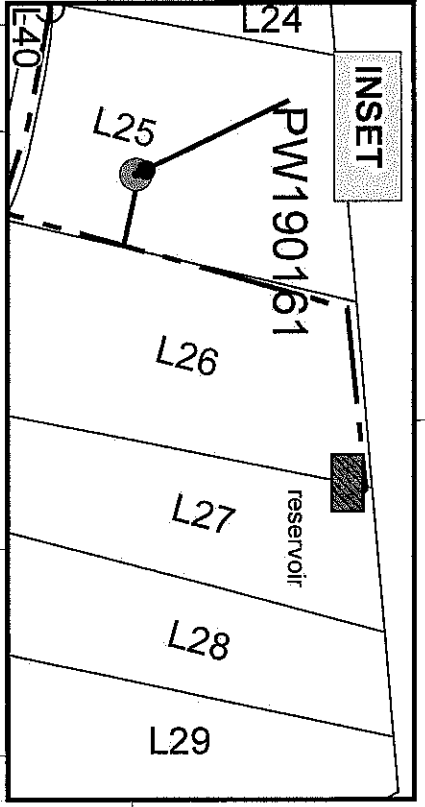

Mapsheet: 0921016

Land District: KDYD

Water District: Nicola

Precinct: Lower Nicola

Signature:

Date: October 21, 2016

